


What's wrong with these pictures?



- 1) Open file drawer.** Unattended, open file drawers pose a tripping hazard.
- 2) Sprinkler head blocked by boxes.** Boxes should be removed at least 18 inches so sprinkler can function.

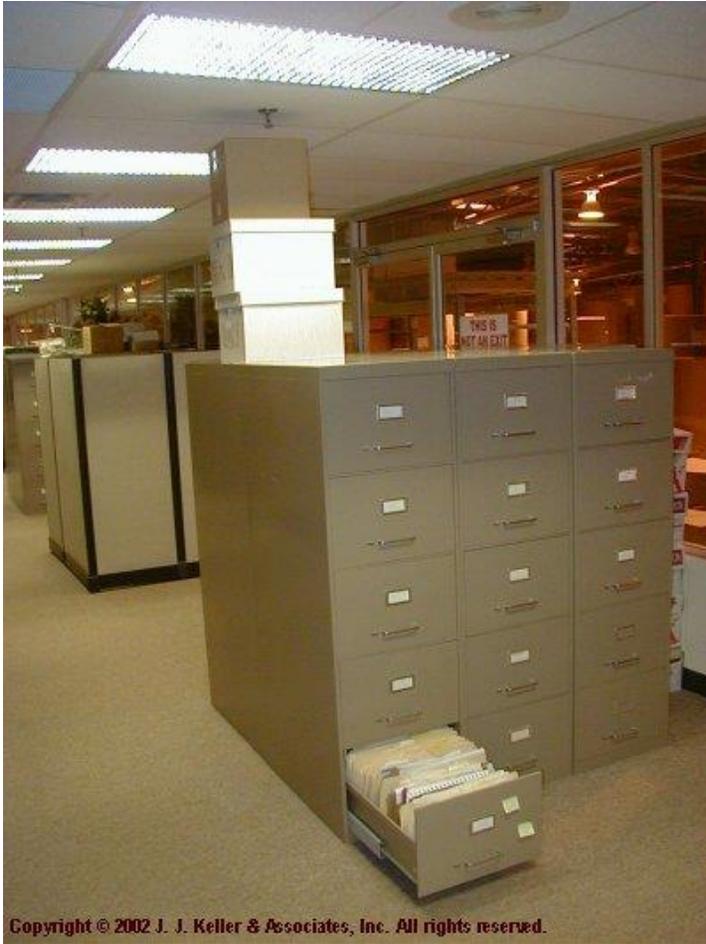

- 1) More than one file drawer open at a time.** File cabinet may fall on employee. Employee may trip on bottom drawer.
- 2) Open drawers make reaching awkward.**
- 3) When stooping to get material from a lower drawer, employee could hit her head on an upper drawer.**